

ICC-ES Evaluation Report

ESR-3371

Reissued September 2025

Revised April 2026


Subject to renewal September 2027

This report also contains:

- [City of LA Supplement](#)
- [CA Supplement w/ DSA and OSHPD](#)
- [FL Supplement](#)

ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.

Copyright © 2026 ICC Evaluation Service, LLC. All rights reserved.

<p>DIVISION: 03 00 00 - CONCRETE</p> <p>Section: 03 16 00— Concrete Anchors</p>	<p>REPORT HOLDER: NITROSET, LLC</p> <p>ADDITIONAL LISTEE: MAGNUM TOOL CORP, INC</p>	<p>EVALUATION SUBJECT: NITROSET SOLID PROPELLANT DRIVEN PINS AND CEILING CLIP ASSEMBLIES</p>	
---	---	---	---

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2024, 2021, 2018 and 2015 [International Building Code® \(IBC\)](#)
- 2024, 2021, 2018 and 2015 [International Residential Code® \(IRC\)](#)

Section number references in this report are for the 2024 IBC and IRC and the standards referenced therein. Corresponding section numbers for earlier code editions are shown in [Table 4](#) at the end of this report.

Property evaluated:

- Structural

2.0 USES

Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies are used as alternatives to the cast-in-place anchors described in IBC Section 1901.3 for placement in concrete. The pins are power-actuated fasteners (PAFs) used to attach cold-formed steel and other building elements to normalweight concrete, and sand-lightweight concrete filled steel deck panels. The ceiling clip assemblies are used as supporting hardware for suspended ceiling systems and are installed in base materials of normalweight concrete and steel deck panels filled with sand-lightweight concrete. The pins and ceiling clip assemblies may be used under the IRC where an engineered design is submitted in accordance with IRC Section R301.1.3.

The PAFs are intended for use in redundant applications, which are defined as applications where multiple PAFs support elements that are capable of redistributing the load to neighboring PAFs, in the event of a PAF failure. Examples include, but are not limited to, PAFs used to fasten cold-formed steel track, where the track can redistribute loads and PAF assemblies where the supported elements, such as conduit and ceiling framing can redistribute the loads to neighboring PAF assemblies.

3.0 DESCRIPTION

3.1 General: Pins and ceiling clips names for the report holder and for the additional listee are presented in the following table:

Company Name:	Nitroset, LLC	Magnum Tool Corp, Inc.	Company Name:	Nitroset, LLC	Magnum Tool Corp, Inc.
Pin names:	PIN 219 (NIT-PIN219)	MAG-PIN219	Ceiling Clip names:	CLU222 (NIT-CLU222)	MAG-CLU222
	PIN 222 (NIT-PIN222)	MAG-PIN222		CLAS525 (NIT-CLU525)	MAG-CLAS525
	PIN 525 (NIT-PIN525)	MAG-PIN525		CLAS532 (NIT-CLU532)	MAG-CLAS532
	PIN 532 (NIT-PIN532)	MAG-PIN532		NIT-CLD90-6ST22	MAG-CLD90-6ST22
	NIT-PIN-6ST19	MAG-PIN-6ST19		NIT-CLD90-6ST25	MAG-CLD90-6ST25
	NIT-PIN-6ST22	MAG-PIN-6ST22		NIT-CLD90-6S32	MAG-CLD90-6S32
	NIT-PIN-6ST25	MAG-PIN-6ST25			
	NIT-PIN-6ST32	MAG-PIN-6ST32			

3.2 Pins: The pins are power-actuated fasteners (PAFs) manufactured from carbon steel wire complying with the manufacturer's specifications. The fasteners are heat-treated after forming and have a through hardness of 50 to 54 on the Rockwell C scale. The pins are mechanically zinc-plated to a minimum thickness of 0.0003 inch (0.008 mm). The heads of the Nitroset pins are encapsulated in plastic sleeves which contain a cylindrical charge of nitrocellulose (solid propellant), used in the driving mechanism. The heads of the Magnum pins do not have an encapsulated charge. See [Table 1A](#) for fastener descriptions, including shank type, shank diameter and head diameter.

3.3 Ceiling Clip Assemblies: The ceiling clip assemblies are comprised of a steel bracket (clip) premounted on a Nitroset or Magnum pin. See [Table 1B](#) for assembly designations and associated pins.

3.3.1 Utility Ceiling Clip Assembly: The Nitroset Utility Ceiling Clip Assembly is comprised of a Nitroset pin with a steel or plastic top-hat washer, and a carbon steel clip. The clip is a 111-degree angle measuring $\frac{3}{4}$ inch (19 mm) wide. The 1-inch-long (25 mm) leg is fitted to the fastener and the $\frac{3}{4}$ -inch-long (18.2 mm) leg has a 0.31-inch-diameter (8 mm) hole through which the ceiling wire is attached. The clip is produced from steel complying with ASTM A1008 SS Grade 30 having a base metal thickness of 0.071 inch (1.8 mm). See [Figure 1](#) for a depiction of the assembly.

3.3.2 Standard Ceiling Clip Assembly: The Nitroset Standard Ceiling Clip Assembly is comprised of a Nitroset pin and a carbon steel clip. The clip is a 135-degree angle, with an offset in the fastened leg, and is $\frac{3}{4}$ inch (19 mm) wide. The $\frac{3}{4}$ -inch-long (19 mm) leg is fitted to the fastener and the $\frac{7}{8}$ -inch-long (21.5 mm) leg has a 0.29-inch-diameter (7.4 mm) hole through which the ceiling wire is attached. The clip is produced from steel complying with ASTM A1008 SS Grade 30 having a base metal thickness of 0.071 inch (1.8 mm). See [Figure 2](#) for a depiction of the assembly.

3.3.3 90 Degree Clip Assembly: The 90 Degree Clip Assembly is comprised of a Nitroset or Magnum pin and a carbon steel clip. The clip is a 90-degree angle, with an offset in the fastened leg, and is $\frac{3}{4}$ inch (19 mm) wide. The $1\frac{5}{16}$ -inch-long (33 mm) leg is fitted to the fastener and the $\frac{7}{8}$ -inch-long (23 mm) leg has a 0.29-inch-diameter (7.30 mm) hole through which the ceiling wire is attached. The clip is produced from steel complying with ASTM A1008 carbon steel type B having a base metal thickness of 0.071 inch (1.8 mm). See [Figure 3](#) for a depiction of the assembly.

3.4 Substrate Materials:

3.4.1 Concrete: Normalweight and sand-lightweight concrete must comply with IBC Chapter 19 or IRC Section R402.2, as applicable. The minimum concrete compressive strength at the time of PAF installation must be as noted in [Table 2](#) or [3](#), as applicable.

3.4.2 Steel Deck Panels: Steel deck panel properties and configurations must be as described in the footnotes to [Table 3](#).

4.0 DESIGN AND INSTALLATION

4.1 Design:

4.1.1 General: Design of the connection of attached material to the base material must take into account the properties of the attached material and the need for redundancy, and must comply with the applicable requirements of the IBC.

Selection of pins must take into consideration the length of the fastener. The minimum effective shank length shown in [Table 1A](#) must equal or exceed the sum of the thickness of the attached material and the minimum embedment depth shown in the applicable table in this report.

4.1.2 Allowable Loads: The allowable tension, shear and 45-degree-angle loads for the pins and ceiling clip assemblies installed in normalweight concrete are provided in [Table 2](#). The allowable shear and tension loads for the pins and ceiling clip assemblies installed in concrete filled steel deck panels are provided in [Table 3](#).

The most critical applied loads, excluding seismic load effects, resulting from the load combinations in Section 2.4 of ASCE 7 or IBC Section 1605.2 must not exceed these allowable loads. For pins which are subjected to seismic loads, see Section 4.1.4 for additional information. The stress increases and load reductions described in IBC Section 1605.2 are not allowed.

Allowable loads described in this report apply to the connection of the pins and ceiling clip assemblies to the base material only. Other limit states applicable to the design of a connection, such as fastener pull-through (pull-over) and lateral bearing on the attached material, which are governed by the properties of attached materials, are outside the scope of this report. Design of the connection of the attached material to the pin or clip must comply with the applicable requirements of the IBC.

4.1.3 Combined Loading: For pins subjected to tension and shear loads, compliance with the following interaction equation must be verified:

$$(p/P_a) + (v/V_a) \leq 1$$

where:

p = Actual applied tension load on fastener, lbf (N).

P_a = Allowable tension load on fastener, lbf (N).

v = Actual applied shear load on fastener, lbf (N).

V_a = Allowable shear load on fastener, lbf (N).

4.1.4 Seismic Considerations: The Nitroset pins and ceiling clip assemblies have been evaluated for use when subjected to seismic loads as follows:

1. The pins and assemblies may be used for attachment of nonstructural components listed in Table 13.1-1 of ASCE 7, which are exempt from the requirements of ASCE 7.
2. Concrete base materials: The pins and assemblies installed in concrete may be used to support acoustical tile or lay-in panel suspended ceiling systems, distributed systems and distribution systems where the service load on any individual pin does not exceed the lesser of 90 lbf (400 N) or the published allowable load in [Tables 2](#) and [3](#), as applicable.
3. For interior, nonstructural walls that are not subject to sustained tension loads and are not a bracing application, the pins may be used to attach steel track to concrete in all Seismic Design Categories. In Seismic Design Categories D, E, and F, the allowable shear load due to transverse pressure must be no more than 90 pounds (400 N). Substantiating calculations must be submitted addressing the pin-to-base-material capacity and the pin-to-attached-material capacity. Interior nonstructural walls are limited to locations where bearing walls, shear walls or braced walls are not required by the approved plans. The design load on the fastener must not exceed the allowable loads established in this report.

4.2 Installation:

Installation procedures must be in accordance with this report and the Nitroset or Magnum published installation instructions. A copy of these instructions must be available on the jobsite at all times during installation.

Installation of Nitroset fasteners and ceiling clip assemblies requires the use of a tool which activates the solid propellant mounted on the fastener, in accordance with the Nitroset published installation instructions.

Installation of Magnum fasteners and ceiling clip assemblies requires the use of a power fastening tool in accordance with the Magnum fastener instructions and the tool manufacturer's instructions.

Minimum spacing between embedded fasteners must be 4 inches (102 mm), and minimum edge distance must be 4 inches (102 mm). Concrete thickness must be a minimum of three times the embedment depth of the fastener. Fasteners must not be driven until the concrete has reached the specified concrete strength noted in [Table 2](#) or [3](#), as applicable.

5.0 CONDITIONS OF USE:

The Nitroset pins and ceiling clip assemblies described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 The pins and ceiling clip assemblies are manufactured and identified in accordance with this report.
- 5.2 Pin and ceiling clip assembly installation must comply with this report and the Nitroset or Magnum published installation instructions, as applicable. In the event of a conflict between this report and the published installation instructions, the more restrictive requirements govern.

- 5.3 Calculations demonstrating that the actual loads are less than the allowable loads described in this report must be submitted to the code official for approval. The calculations and details must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.4 Refer to Section 4.1.4 for seismic considerations.
- 5.5 The use of the pins and ceiling clip assemblies is limited to dry, interior locations, which include exterior walls which are protected by an exterior wall envelope.
- 5.6 The use of pins and ceiling clip assemblies is limited to installation in uncracked concrete. Cracking occurs when $f_t > f_r$ due to service loads or deformations.
- 5.7 The pins and ceiling clip assemblies are manufactured under a quality control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

Data in accordance with the [ICC-ES Acceptance Criteria for Power-actuated Fasteners Driven into Concrete, Steel and Masonry Elements AC70 \(24\)](#), dated April 2025.

7.0 IDENTIFICATION

- 7.1 The ICC-ES mark of conformity, electronic labeling, or the evaluation report number (ICC-ES ESR-3371) along with the name, registered trademark, or registered logo of the report holder or listee must be included in the product label.
- 7.2 In addition, pins are imprinted with an 'N' on the head as shown in [Figure 4](#) and packages of pins and ceiling clip assembly packaging are labeled with the product designation and the pin description.
- 7.3 The report holder's contact information is the following:

NITROSET, LLC
5600 BONHOMME ROAD, SUITE D
HOUSTON, TEXAS 77036
(800) 524-4649
www.nitroset.com

- 7.4 The additional listee's contact information is the following:

MAGNUM TOOL CORP, INC
5600 BONHOMME ROAD, SUITE B
HOUSTON, TEXAS 77036
(713) 781-5671
www.magnum-tool.com
sales@magnum-tool.com



FIGURE 1—UTILITY CEILING CLIP ASSEMBLY



FIGURE 2—STANDARD CEILING CLIP ASSEMBLY



FIGURE 3—90 DEGREE CEILING CLIP ASSEMBLY



FIGURE 4—FASTENER HEAD MARKING

TABLE 1A—NITROSET & MAGNUM POWER-ACTUATED FASTENERS

PIN DESIGNATION	SHANK STYLE		SHANK DIAMETER (in.)	HEAD DIAMETER (in.)	MAXIMUM POINT LENGTH ¹ (inch)	SHANK LENGTH (in.)	MIN. EFFECTIVE SHANK LENGTH ² (inch)
PIN 219 (NIT-PIN219)	Smooth		0.125	0.289	0.26	3/4	0.728
PIN 222 (NIT-PIN222)						7/8	0.846
PIN 525 (NIT-PIN525)	Step		0.145 / 0.130	0.289	0.28	1	0.945
PIN 532 (NIT-PIN532)						1 1/4	1.181
NIT-PIN-6ST19	Smooth		0.157	0.289	0.28	3/4	0.719
NIT-PIN-6ST22						7/8	0.844
NIT-PIN-6ST25						1	0.969
NIT-PIN-6ST32						1 1/4	1.219

For SI: 1 inch = 25.4 mm.

¹Maximum point length is the maximum specified length from the tip of the fastener to the location where the diameter of the shank becomes constant.

²Minimum effective shank length is the minimum specified length from the underside of the fastener head to the tip of the fastener. The minimum effective shank length must equal or exceed the sum of the thickness of the attached material and the minimum embedment depth shown in Table 2 or Table 3, as applicable.

TABLE 1B—NITROSET & MAGNUM CEILING CLIP ASSEMBLIES

CEILING CLIP DESIGNATION	CLIP TYPE	PIN DESIGNATION
CLU222 (NIT-CLU222)	Utility	PIN 222 (NIT-PIN222)
CLAS525 (NIT-CLU525)	Standard	PIN 525 (NIT-PIN525)
CLAS532 (NIT-CLU532)		PIN 532 (NIT-PIN532)
NIT-CLD90-6ST22	90 Degree	NIT-PIN-6ST22
NIT-CLD90-6ST25		NIT-PIN-6ST25
NIT-CLD90-6S32		NIT-PIN-6ST32

TABLE 2—ALLOWABLE LOADS FOR NITROSET PINS AND ASSEMBLIES INSTALLED IN NORMALWEIGHT CONCRETE ^{1,2,3}

PRODUCT DESIGNATION	EMBEDMENT DEPTH (inches)	ALLOWABLE LOADS (lbf)					
		4,000 psi			6,000 psi		
Concrete Compressive Strength:		Tension	Shear	45-Degree	Tension	Shear	45-Degree
Load Direction:							
CLU222 (NIT-CLU222)	Controlled by clip thickness	120	165	120	115	276	209
CLAS525 (NIT-CLU525)		158	242	151	163	184	168
CLAS532 (NIT-CLU532)		150	147	213	171	146	152
PIN 219 (NIT-PIN219)	5/8	85	70	–	175	65	–
PIN 222 (NIT-PIN222)	3/4	100	200	–	205	100	–
PIN 525 (NIT-PIN525)	13/16	180	195	–	205	185	–
PIN 532 (NIT-PIN532)	1 1/16	250	355	–	200	215	–
NIT-CLD90-6ST22	3/4	101	177	–	120	214	–
NIT-CLD90-6ST25	1	101	144	114	125	210	130
NIT-CLD90-6S32	1 1/4	156	205	105	164	255	130
NIT-PIN-6ST19	5/8	120	174	–	–	–	–
NIT-PIN-6ST22	3/4	138	244	–	142	257	–
NIT-PIN-6ST25	1	138	133	–	150	179	–
NIT-PIN-6ST32	1 1/4	138	158	–	150	214	–

For SI: 1 inch = 25.4 mm, 1 lbf = 4.45 N, 1 psi = 6.89 kPa.

¹Fasteners must not be driven until the concrete has reached the specified compressive strength.

²Concrete thickness at the point of penetration must be a minimum of three times the embedment depth.

³The fasteners listed in the table above may be used for static load conditions and for the seismic load conditions described in Section 4.1.4, as applicable. The tabulated allowable loads apply to static load conditions. For seismic load conditions, the allowable loads must be limited in accordance with Section 4.1.4, Items 2 and 3 of this report, as applicable.

TABLE 3—ALLOWABLE LOADS FOR NITROSET ASSEMBLIES INSTALLED INTO STEEL DECK FILLED WITH SAND-LIGHTWEIGHT CONCRETE THAT HAS A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI^{1,4}

PRODUCT DESIGNATION	MINIMUM EMBEDMENT DEPTH (inch)	ALLOWABLE LOADS (Ibf)					
		Installed through Lower Flute of 3-inch Deep Steel Deck Panel (W-deck) into Concrete ²		Minimum Required Concrete Topping Thickness Above Deck Panel (inches)	Installed through Lower Flute of 1 1/2-inch Deep Steel Deck Panel (B-deck) into Concrete ³		Minimum Required Concrete Topping Thickness Above Deck Panel (inches)
Fastener Location:		Tension	Shear		Tension	Shear	
Load Direction:							
CLU222 (NIT-CLU222)	Controlled by clip thickness	45	180	3 1/2	100	230	5
CLAS525 (NIT-CLU525)		90	280		110	330	
CLAS532 (NIT-CLU532)		140	315		170	355	
PIN 219 (NIT-PIN219)	5/8	20	290		45	240	
PIN 222 (NIT-PIN222)	3/4	80	280		95	325	
PIN 525 (NIT-PIN525)	13/16	55	275		125	340	
PIN 532 (NIT-PIN532)	1 1/16	110	385		175	430	
NIT-CLD90-6ST22	3/4	99	248		104	262	
NIT-CLD90-6ST25	1	104	284		104	293	
NIT-CLD90-6S32	1 1/4	161	353		155	354	
NIT-PIN-6ST19	5/8	115	196		137	269	
NIT-PIN-6ST22	3/4	115	244		137	284	
NIT-PIN-6ST25	1	217	358		198	359	
NIT-PIN-6ST32	1 1/4	217	332		198	382	

For SI: 1 inch = 25.4 mm, 1 Ibf = 4.45 N, 1 psi = 6.89 kPa.

¹Fasteners must not be driven until the concrete has reached the specified compressive strength.

²The steel deck must have a minimum base material thickness of 0.035 inch and conform to the profile requirements as shown in Figure 5A. The steel deck must have a minimum yield strength, F_y , of 40 ksi and a minimum tensile strength of 55 ksi. Fastener edge distance must be a minimum of 1 1/2 inches. Fastener spacing along the length of the steel deck panel must be a minimum of 4 inches.

³The steel deck must have a minimum base material thickness of 0.035 inch and must conform to the profile requirements as shown in Figure 5B. The steel deck must have a minimum yield strength, F_y , of 50 ksi and a minimum tensile strength of 65 ksi. Fastener edge distance must be a minimum of 7/8 inch. Fastener spacing along the length of the steel deck panel must be a minimum of 4 inches.

⁴The fasteners listed in the table above may be used for static load conditions and for the seismic load conditions described in Section 4.1.4, as applicable. The tabulated allowable loads apply to static load conditions. For seismic load conditions, the allowable loads must be limited in accordance with Section 4.1.4, Items 2 and 3 of this report, as applicable.

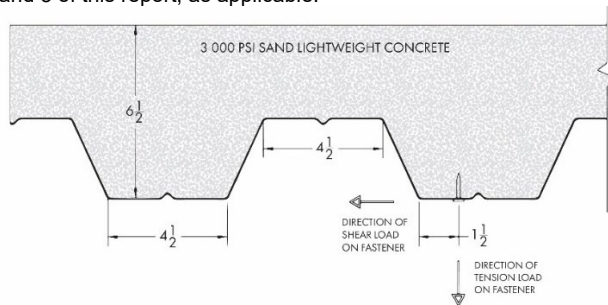


FIGURE 5A—FASTENER INSTALLATION IN 3-INCH-DEEP STEEL DECK

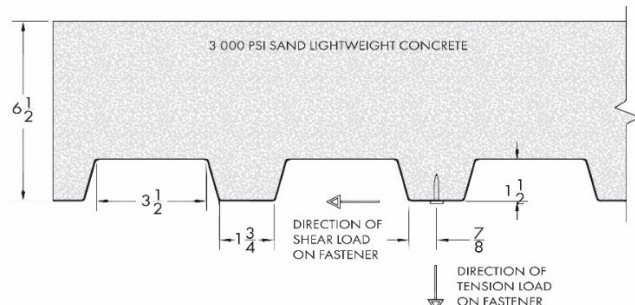


FIGURE 5B—FASTENER INSTALLATION IN 1 1/2-INCH-DEEP STEEL DECK

TABLE 4—CODE SECTION NUMBER REFERENCE MATRIX

IBC			
2024 IBC	2021 IBC	2018 IBC	2015 IBC
ASCE 7-22 2.4 (IBC Section 1605.1)	ASCE 7-16/S1 2.4 (IBC Section 1605.1)	1605.3.1	1605.3.1
1605.2	1605.2	1605.3.2	1605.3.2
1901.3	1901.3	1901.3	1901.3
Other Referenced Standards			
ASCE 7-22 Table 13.1-1	ASCE 7-16 w/S1 13.1.4	ASCE 7-16 13.1.4	ASCE 7-10 w/S1 13.1.4
IRC			
2024 IRC	2021 IRC	2018 IRC	2015 IRC
R301.1.3	R301.1.3	R301.1.3	R301.1.3
R402.2	R402.2	R402.2	R402.2

DIVISION: 03 00 00—CONCRETE

Section: 03 16 00—Concrete Anchors

REPORT HOLDER:

NITROSET, LLC.

EVALUATION SUBJECT:

NITROSET SOLID PROPELLANT DRIVEN PINS AND CEILING CLIP ASSEMBLIES

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in ICC-ES evaluation report [ESR-3371](#), have also been evaluated for compliance with the codes noted below as adopted by the Los Angeles Department of Building and Safety (LADBS).

Applicable code editions:

- 2026 City of Los Angeles Building Code ([LABC](#))
- 2026 City of Los Angeles Residential Code ([LARC](#))

*For evaluation for compliance with the anticipated requirements of the 2026 LABC and LARC

2.0 CONCLUSIONS

The Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in Sections 2.0 through 7.0 of the evaluation report [ESR-3371](#), comply with the LABC Chapter 19 and the LARC, and are subject to the conditions of use described in this supplement.

3.0 CONDITIONS OF USE

The Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies described in this evaluation report supplement must comply with all of the following conditions:

- All applicable sections in the evaluation report [ESR-3371](#).
- The design, installation, conditions of use and identification of the Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies are in accordance with the 2024 *International Building Code*® (IBC) and 2024 *International Residential Code*® (IRC) provisions, as applicable, noted in the evaluation report [ESR-3371](#).
- The design, installation and inspection are in accordance with additional requirements of LABC Chapters 16 and 17, as applicable.
- Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies must not be used to anchor sill plates except at interior nonbearing walls not designed as a shear walls in accordance with Section 1613.9.10.3 item 2 of the LABC.
- Under the LARC, an engineered design in accordance with LARC Section R301.1.3 must be submitted.
- The allowable load values listed in the evaluation report are for the connection of the fasteners or ceiling clip assemblies to normal-weight concrete and lightweight concrete over metal decks only. The connection between the fasteners or ceiling clip assemblies, as applicable, and the connected members must be checked for capacity (which may govern).

This supplement expires concurrently with the evaluation report, reissued September 2025 and revised April 2026.

DIVISION: 03 00 00—CONCRETE
Section: 03 16 00—Concrete Anchors

REPORT HOLDER:

NITROSET, LLC.

EVALUATION SUBJECT:

NITROSET SOLID PROPELLANT DRIVEN PINS AND CEILING CLIP ASSEMBLIES

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in ICC-ES evaluation report [ESR-3371](#), have also been evaluated for compliance with the codes noted below.

Applicable code editions:

- 2025 California Building Code (CBC)

For evaluation of applicable chapters adopted by the [California Office of Statewide Health Planning and Development \(OSHPD\) AKA: California Department of Health Care Access and Information \(HCAI\) and the Division of State Architects \(DSA\)](#), see Sections 2.1.1 and 2.1.2 below.

- 2025 California Residential Code (CRC)

2.0 CONCLUSIONS

2.1 CBC:

The Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in Sections 2.0 through 7.0 of the evaluation report ESR-3371, comply with CBC Chapter 19, provided the design and installation are in accordance with the 2024 *International Building Code*® (IBC) provisions noted in the evaluation report and the additional and inspection requirements of CBC Chapters 16 and 17, as applicable.

2.1.1 OSHPD:

The Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in Sections 2.0 through 7.0 of the evaluation report [ESR-3371](#), comply with CBC amended Chapters 19 [OSHPD 1R, 2, 3, 5 and 6], and Chapters 19A [OSHPD 1 & 5], provided the design and installation are in accordance with the 2024 *International Building Code*® (IBC) provisions noted in the evaluation report and the additional requirements in Sections 2.1.1.1 and 2.1.1.2 of this supplement:

2.1.1.1 Verification Test Requirements: The installation verification test loads, frequency, and acceptance criteria shall be in accordance with Section 1901.3.4 [OSHPD 1R, 2, 3, 5 and 6] or 1910A.5 [OSHPD 1 & 5] of the CBC, as applicable.

2.1.1.2 Conditions of Use:

2.1.1.1.1 Power-actuated fastener use in seismic shear applications shall be in accordance with Section 1901.3.1 [OSHPD 1R, 2, 3, 5 & 6] or 1617A.1.20 [OSHPD 1, 4 & 5].

2.1.2 DSA:

The Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in Sections 2.0 through 7.0 of the evaluation report [ESR-3371](#), comply with CBC amended Chapter 19 [DSA-SS/CC], and Chapter 19A [DSA-SS], provided the design and installation are in accordance with the 2024 *International Building Code*® (IBC) provisions noted in the evaluation report and the additional requirements in Sections 2.1.2.1 and 2.1.2.2 of this supplement:

2.1.2.1 Verification Test Requirements: The installation verification test loads, frequency, and acceptance criteria shall be in accordance with Section 1909.2.6 [DSA-SS/CC] and 1910A.5 [DSA-SS] of the CBC, as applicable.

2.1.2.2 Conditions of Use:

2.1.2.2.1 Power-actuated fastener use in seismic shear applications shall be in accordance with Section 1617A.1.20 [DSA-SS].

2.2 CRC:

The Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in Sections 2.0 through 7.0 of the evaluation report [ESR-3371](#), comply with CRC Section R301.1.3, provided the design and installation are in accordance with the 2024 *International Building Code*® (IBC) provisions noted in the evaluation report and the additional requirements of CBC Chapters 16 and 17.

This supplement expires concurrently with the evaluation report, reissued September 2025 and revised April 2026.

DIVISION: 03 00 00—CONCRETE
Section: 03 16 00—Concrete Anchors

REPORT HOLDER:

NITROSET, LLC

EVALUATION SUBJECT:

NITROSET SOLID PROPELLANT DRIVEN PINS AND CEILING CLIP ASSEMBLIES

1.0 REPORT PURPOSE AND SCOPE**Purpose:**

The purpose of this evaluation report supplement is to indicate that Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in ICC-ES evaluation report [ESR-3371](#), have also been evaluated for compliance with the codes noted below.

Applicable code editions:

- 2023 Florida Building Code—Building
- 2023 Florida Building Code—Residential

2.0 CONCLUSIONS

The Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies, described in Sections 2.0 through 7.0 of ICC-ES evaluation report [ESR-3371](#), comply with the *Florida Building Code—Building* and *Florida Building Code—Residential*. The design requirements must be determined in accordance with the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable. The installation requirements noted in ICC-ES evaluation report [ESR-3371](#) for the 2021 *International Building Code*® meet the requirements of the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable.

Use of the Nitroset Solid Propellant Driven Pins and Ceiling Clip Assemblies for compliance with the High-Velocity Hurricane Zone provisions of the *Florida Building Code—Building* or the *Florida Building Code—Residential* has not been evaluated and is outside the scope of this supplemental report.

For products falling under Florida Rule 61G20-3, verification that the report holder's quality assurance program is audited by a quality assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official when the report holder does not possess an approval by the Commission). Florida Rule 61G20-3 is applicable to products and/or systems which comprise the building envelope and structural frame for compliance with the structural requirements of the Florida Building Code.

This supplement expires concurrently with the evaluation report, reissued September 2025 and revised April 2026.